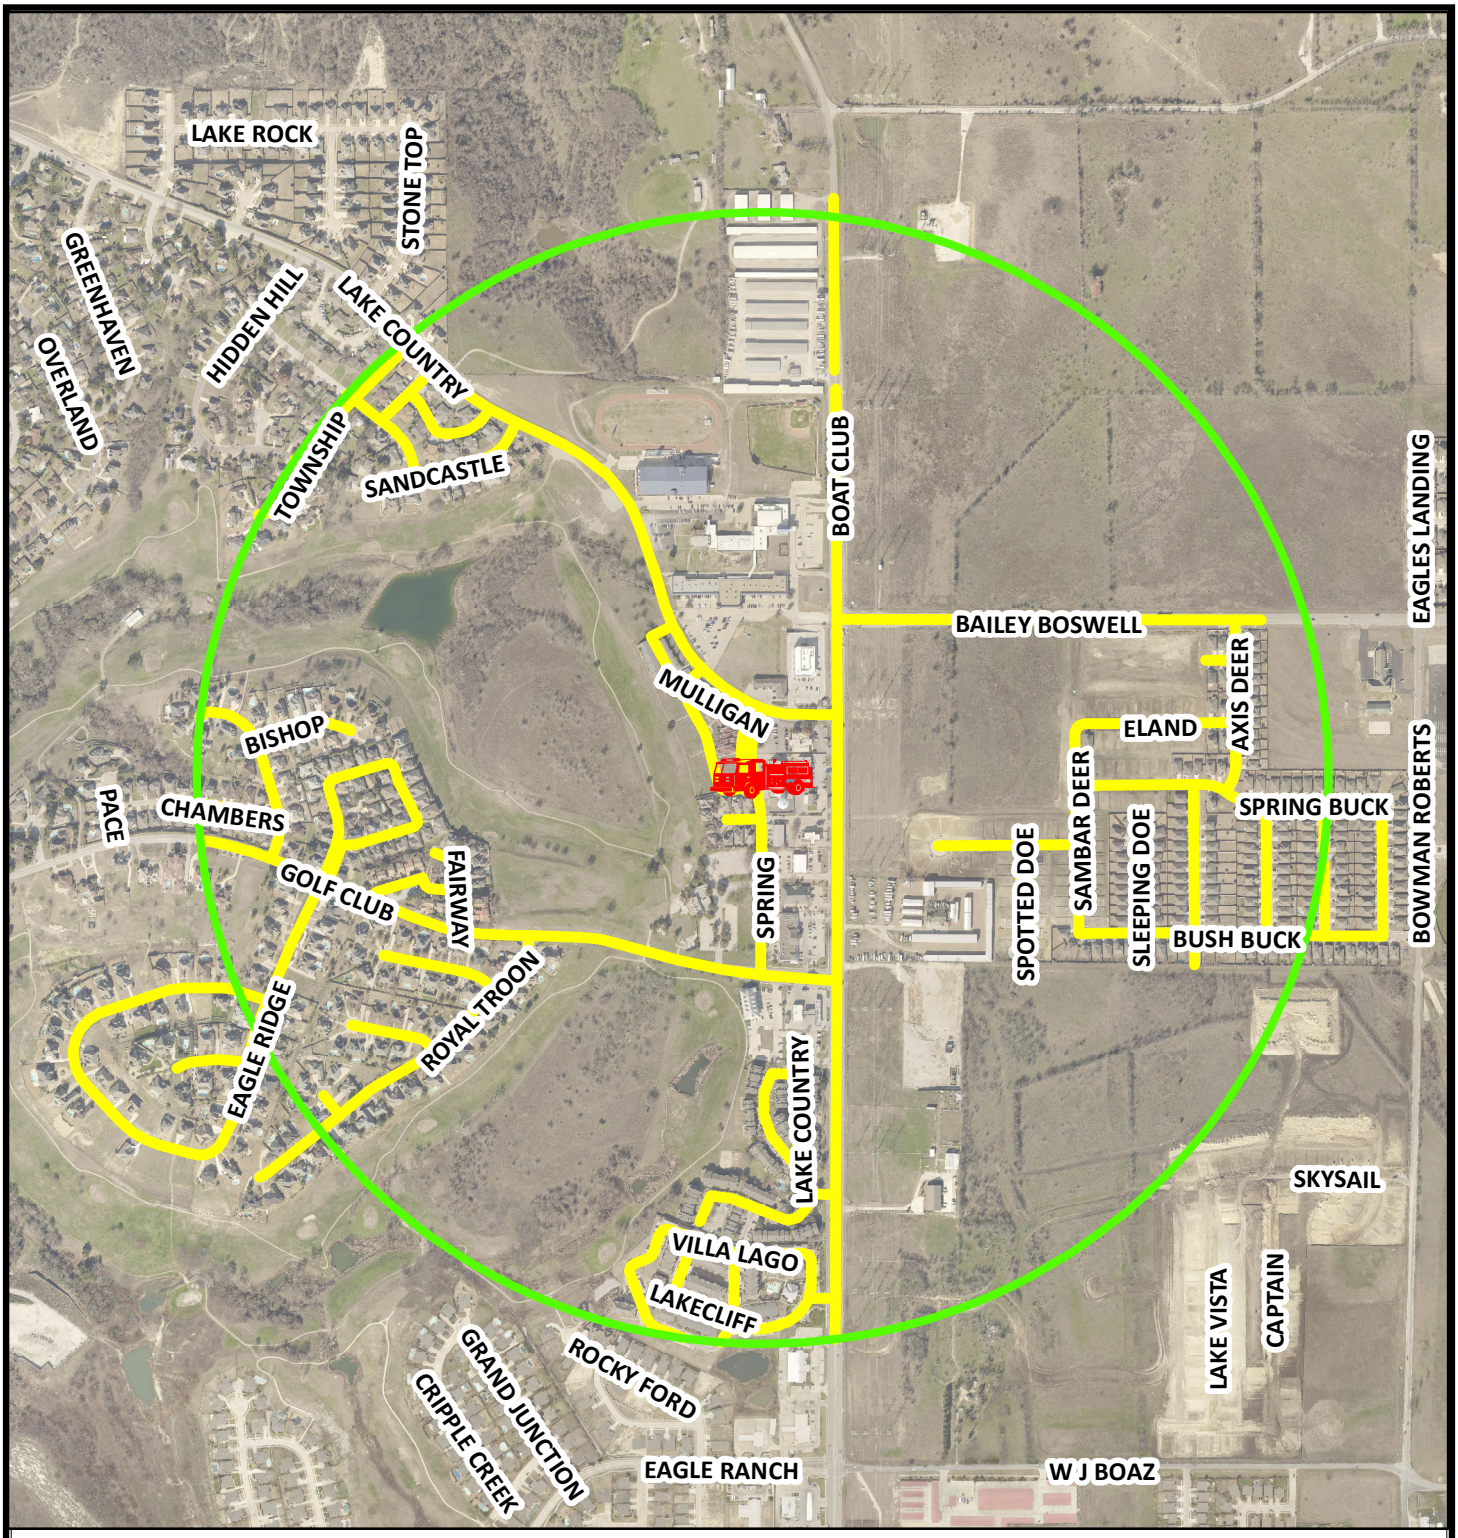

Targeted Spray Consideration

8510 Spring St

Fire Station 40

Spray Route (8.64 linear miles)

0 0.25 0.5

Miles

FORT WORTH®

CODE COMPLIANCE