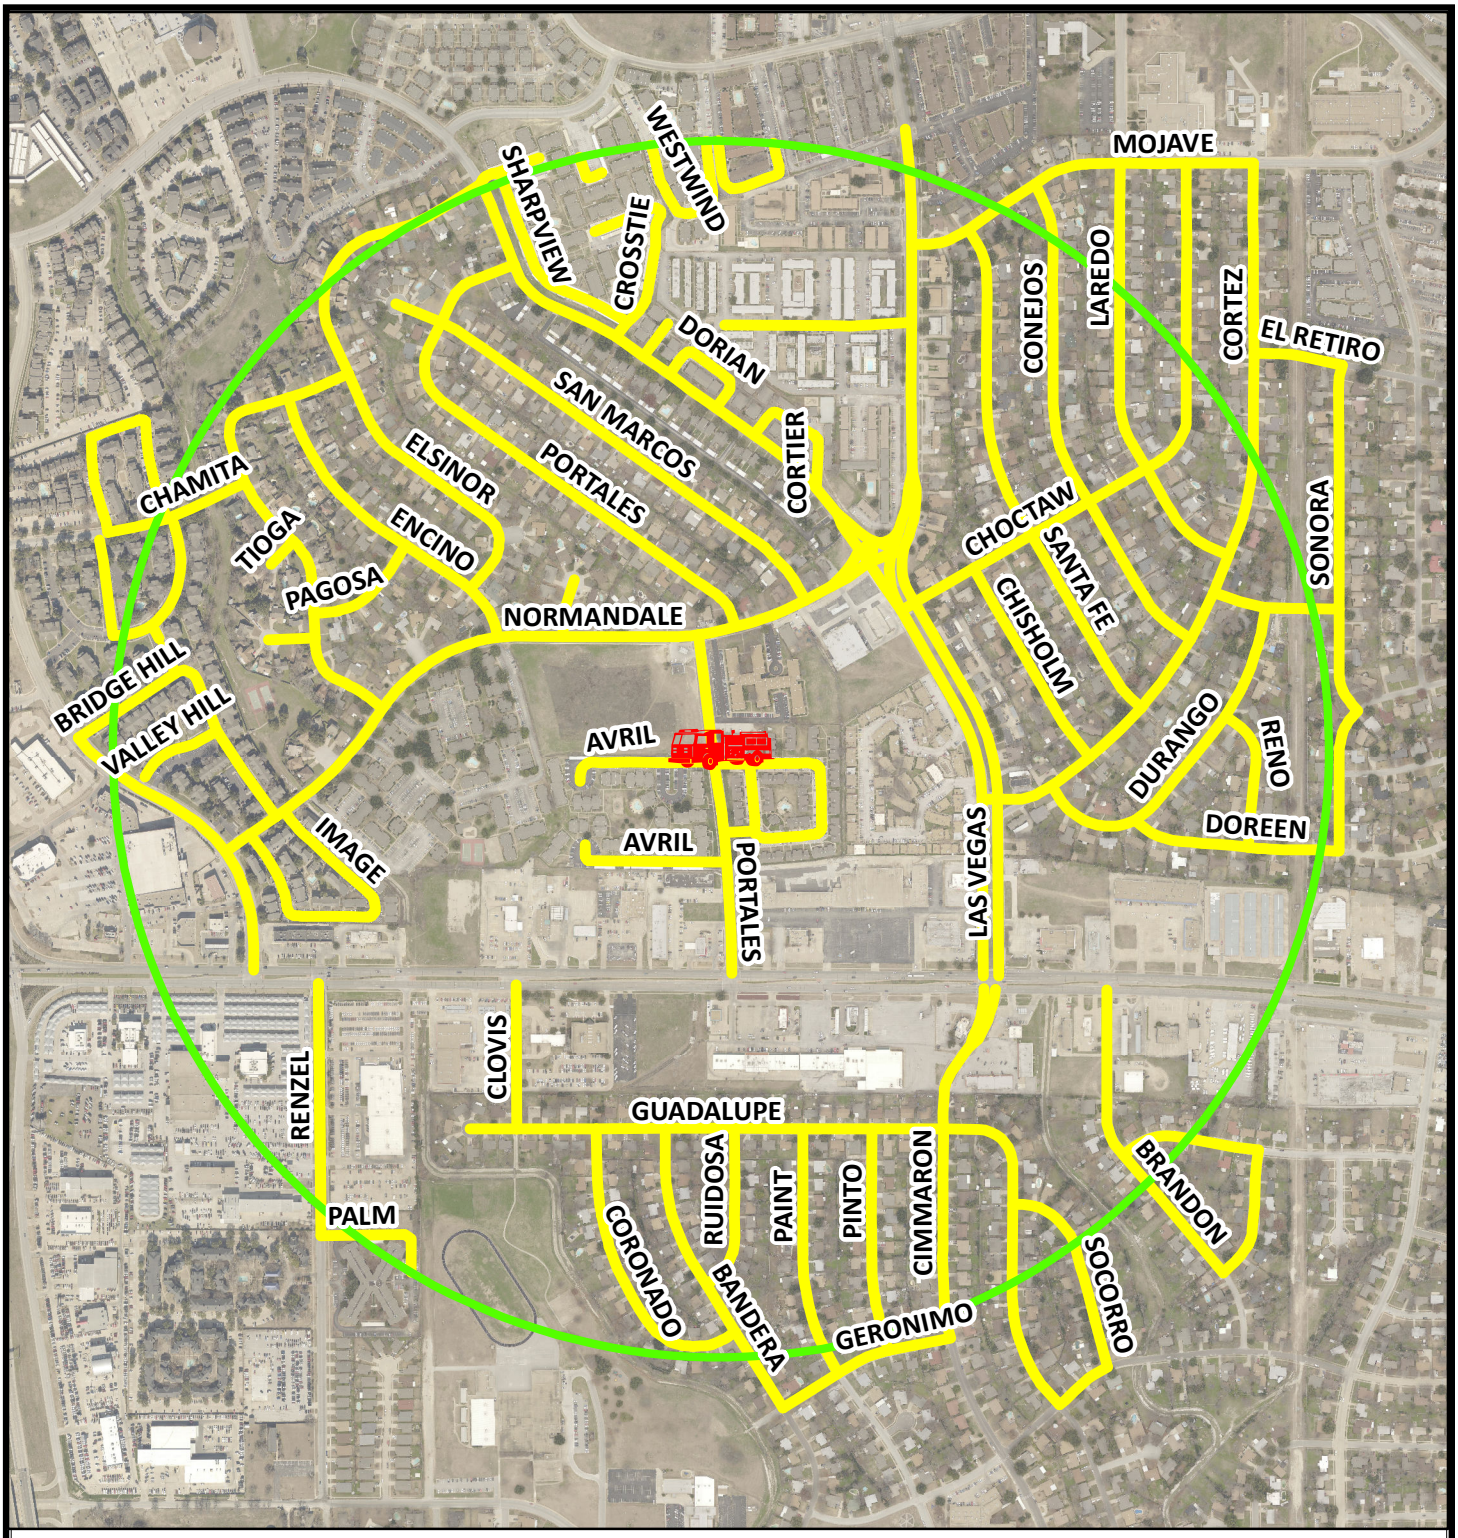

Testing Site

3201 Portales

Fire Station 23

Spray Route (15.50 linear miles)

0 0.25 0.5

Miles

FORT WORTH®